


NOTES:

1. TRAFFIC BEARING BOX REQUIRED IN TRAFFIC AREAS.
2. SEWER LATERAL AND CLEANOUT PIPING SHALL BE ASTM D3034 SDR26, SEWER LATERAL FITTINGS SHALL BE OF THE SAME SDR RATING AS SEWER MAIN. SCHEDULE 40 SOLVENT WELD PIPE AND FITTINGS MAY BE USED FOR THE CLEANOUT ASSEMBLY ONLY.
3. ALL PIPE SHALL BE OF SIZE SHOWN.
4. NO BENDS ARE ALLOWED IN THE LATERAL FROM THE MAIN TO THE CLEANOUT STACK WYE. (EXCEPT AS NOTED)
5. ALL MAIN LINE TAPS ON ACTIVE MAIN SHALL BE PERFORMED BY TOWN OF CHRISTIANSBURG OR UNDER SUPERVISION OF THE TOWN OF CHRISTIANSBURG.
6. PIPING ON PRIVATE SIDE OF CLEANOUT TO BE INSTALLED PER TOWN REQUIREMENTS.
7. MINIMUM COVER FOR ALL SEWER LATERALS SHALL BE THREE (3') FEET.
8. PROPERTY OWNER RESPONSIBLE FOR INSTALLING CLEANOUT ON PROPERTY LINE WHEN MAINTENANCE OCCURS, IN ACCORDANCE WITH THIS DETAIL.

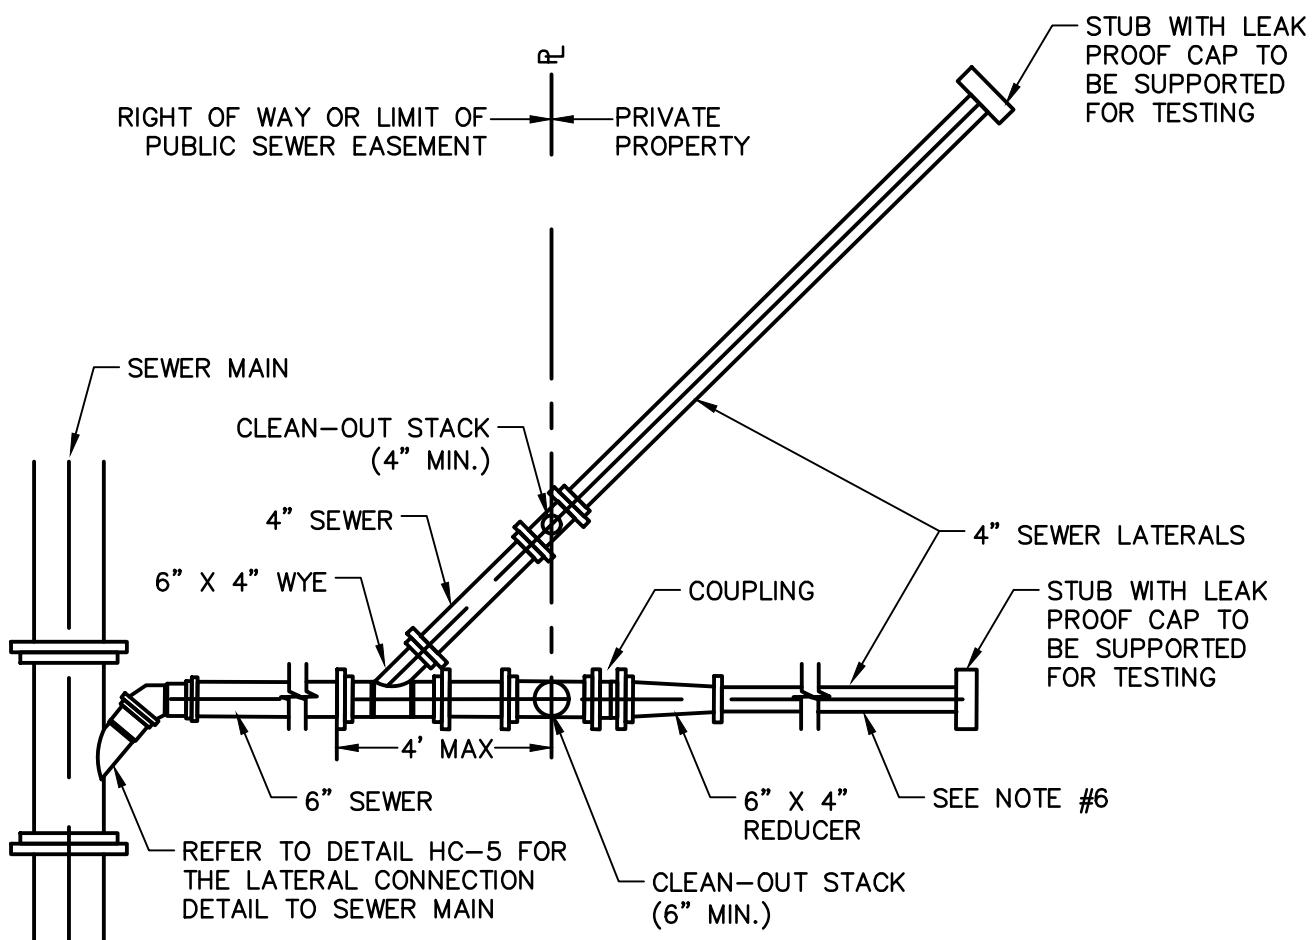

ENGINEERING
DEPARTMENT
100 EAST MAIN STREET
CHRISTIANSBURG, VA 24073
(540) 382-6120 PHONE
(540) 381-7238 FAX
engineering@christiansburg.org

DOUBLE SEWER LATERAL
COMBINED 6" BY TWO 4" LATERALS

DATE: 05 JAN 2021
SCALE: N.T.S.
DETAIL NO.
HC-6