


*ROD GATE VALVES TO TEES OR
USE MEGALUG MJ RESTRAINTS

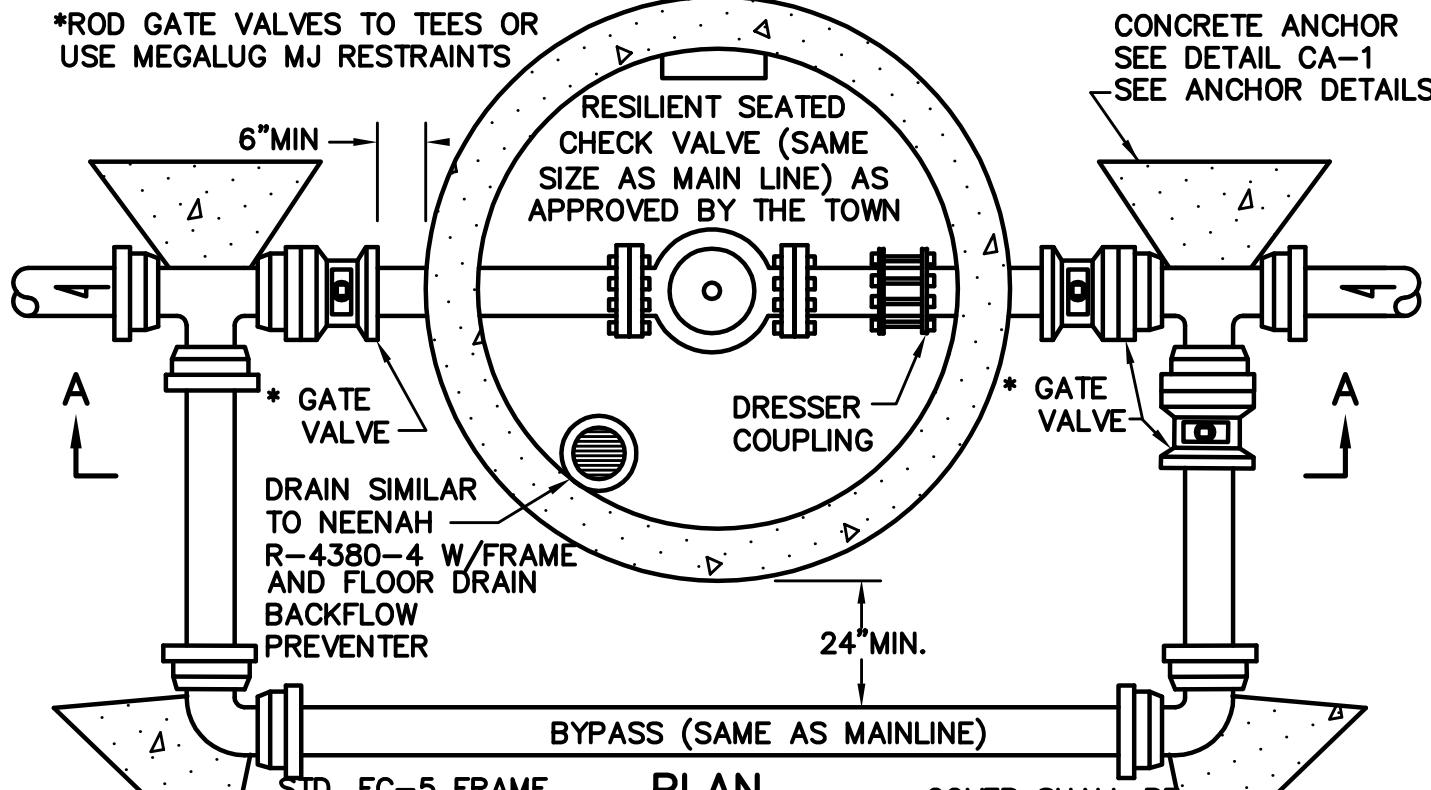

CONNECT PIPE TO SECTION WITH APPROVED WATERTIGHT SLEEVE OR GASKET

STANDARD VB-1 VALVE BOX & COVER (TYP)

PIPE TO STORM SEWER OR DISCHARGE TO 2'x2'x2' DRY WELL, VDOT NO. 57 STONE. USE 4" POLYETHYLENE PLASTIC CORRUGATED TUBING, ASTM F405



ENGINEERING
DEPARTMENT
100 EAST MAIN STREET
CHRISTIANSBURG, VA 24073
(540) 382-6120 PHONE
(540) 381-7238 FAX
engineering@christiansburg.org

CHECK VALVE ASSEMBLY
AND BYPASS

DATE: 11 AUG 2014
SCALE: N.T.S.
DETAIL NO.
CV-1