


PLAN

BOTTOM OF TOP BRICK SHALL BE EVEN WITH TOP OF BONNET BOLT FLANGE (BASE SIZE SHALL BE SUFFICIENT TO PERMIT INSTALLATION AS SHOWN)

MORTAR

VALVE BOX  
(LOWER PORTION SHOWN)

COMPACTED BACKFILL TO NATURAL GROUND

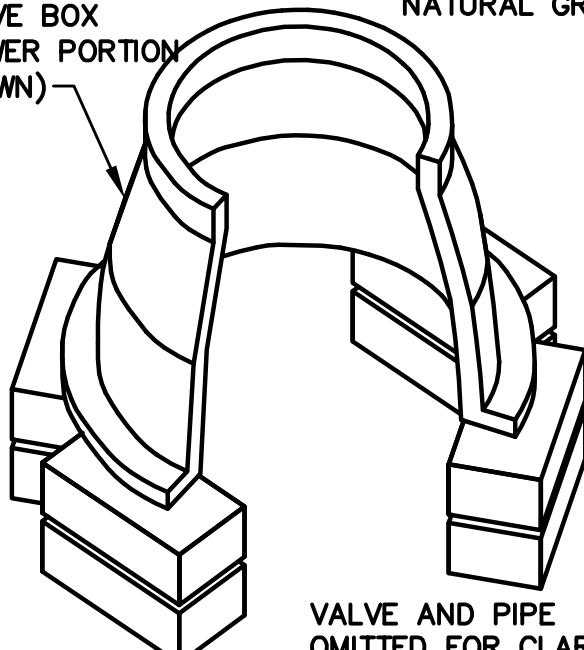

ISOMETRIC VIEW

A 6"X6" CONCRETE COLLAR  
SHALL BE USED WHERE  
SURFACE IS NOT PAVED

CAST IRON COVER  
SHALL MATCH EXISTING  
OR PROPOSED GRADE

36" MIN

SUPPORT BOX  
WITH MINIMUM OF  
THREE (3) COURSES  
OF BRICK

MORTAR  
JOINT

4"

SUPPORT VALVE WITH SOLID CONCRETE  
BLOCK OR CONCRETE BEARING PAD  
AS REQUIRED BY TOWN

SECTION

VALVE BOX  
INSTALLATION



ENGINEERING  
DEPARTMENT  
100 EAST MAIN STREET  
CHRISTIANSBURG, VA 24073  
(540) 382-6120 PHONE  
(540) 381-7238 FAX  
[engineering@christiansburg.org](mailto:engineering@christiansburg.org)

DATE: 11 AUG 2014  
SCALE: N.T.S.  
DETAIL NO.  
VB-1